

PRILOGE:

Priloga 1: Temperaturni diagram za zunanjo normno temperaturo -19°C

A). Temperaturni diagram za zunanjo normno temperaturo -19°C (SON-KPV-TTOPPTPP-V-01 ($140/70^{\circ}\text{C}$, NP16))

B). Temperaturni diagram za zunanjo normno temperaturo -19°C (SON-KPV-TTOPPTPP-V-01 ($130/70^{\circ}\text{C}$, NP16))

C). Temperaturni diagram za zunanjo normno temperaturo -19°C (SON-KPV-TTOPPTPP-V-01 ($120/70^{\circ}\text{C}$, NP16))

D). Temperaturni diagram za zunanjo normno temperaturo -19°C (SON-KPV-TTOP2COMRVG-V-01 ($110/70^{\circ}\text{C}$, NP6))


E). Temperaturni diagram za zunanjo normno temperaturo -19°C (SON-KPV-TTOP2COMRVG-V-01 ($85/65^{\circ}\text{C}$, NP3))

Priloga 1: Temperaturni diagrami za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$

A). Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$
(SON-KPV-TTOPPTPP-V-01 (140/70 $^{\circ}\text{C}$))

Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$

(SON-KPV-TTOPPTPP-V-01 (140/70 $^{\circ}\text{C}$ NP16))

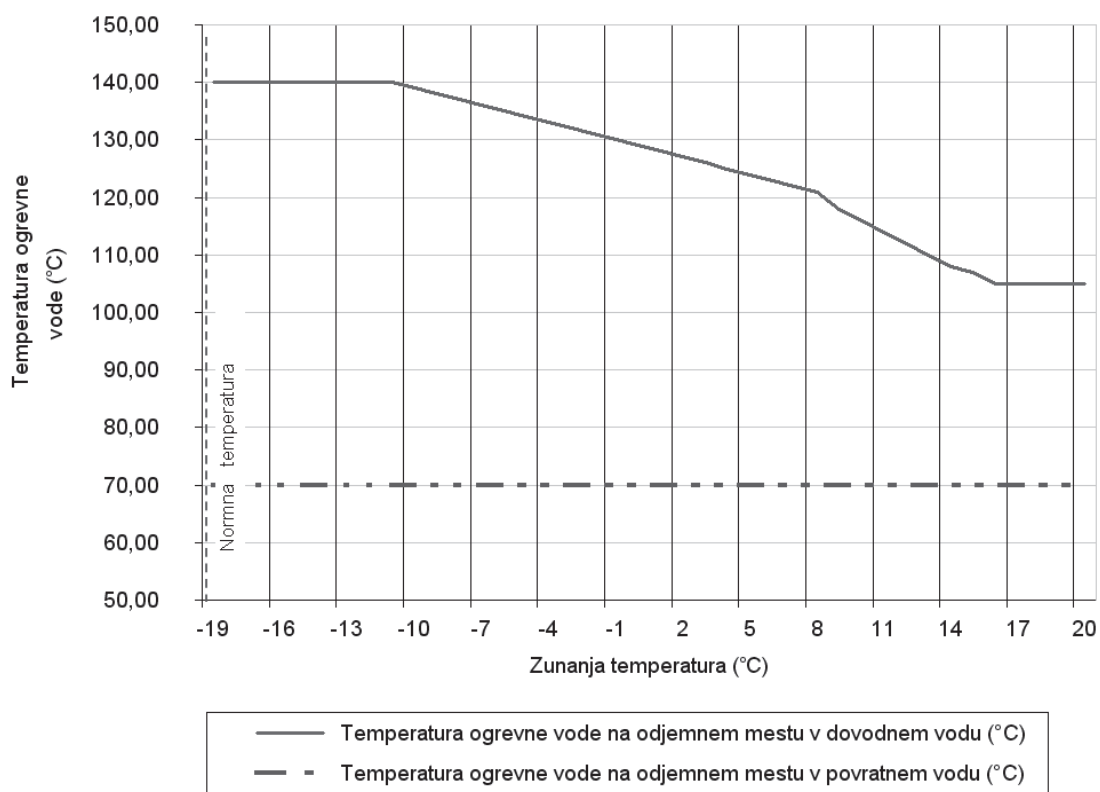


Opomba:

Dovoljeno odstopanje temperature ogrevne vode na posameznem odjemnem mestu v dovodnem vodu je $\pm 3\text{ }^{\circ}\text{C}$.

B). Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$
(SON-KPV-TTOPPTPP-V-01 (130/70 $^{\circ}\text{C}$))

Temperaturni diagram za zunanjo normno temperaturo -19°C


SON-KPV- TTOPPTPP -V-01 (130/70 $^{\circ}\text{C}$, NP16)

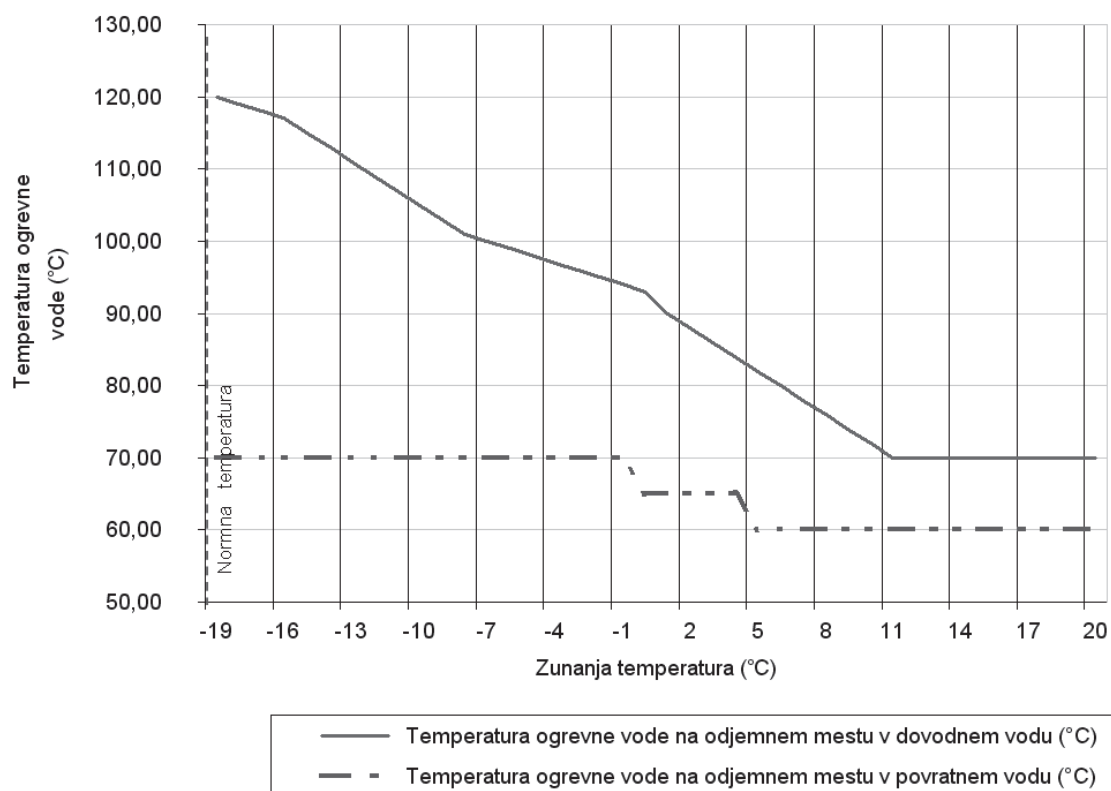

Opomba:

Dovoljeno odstopanje temperature ogrevne vode na posameznem odjemnem mestu v dovodnem vodu je $\pm 3\text{ }^{\circ}\text{C}$.

C). Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$
(SON-KPV-TTOPPTPP-V-01 (120/70 $^{\circ}\text{C}$))

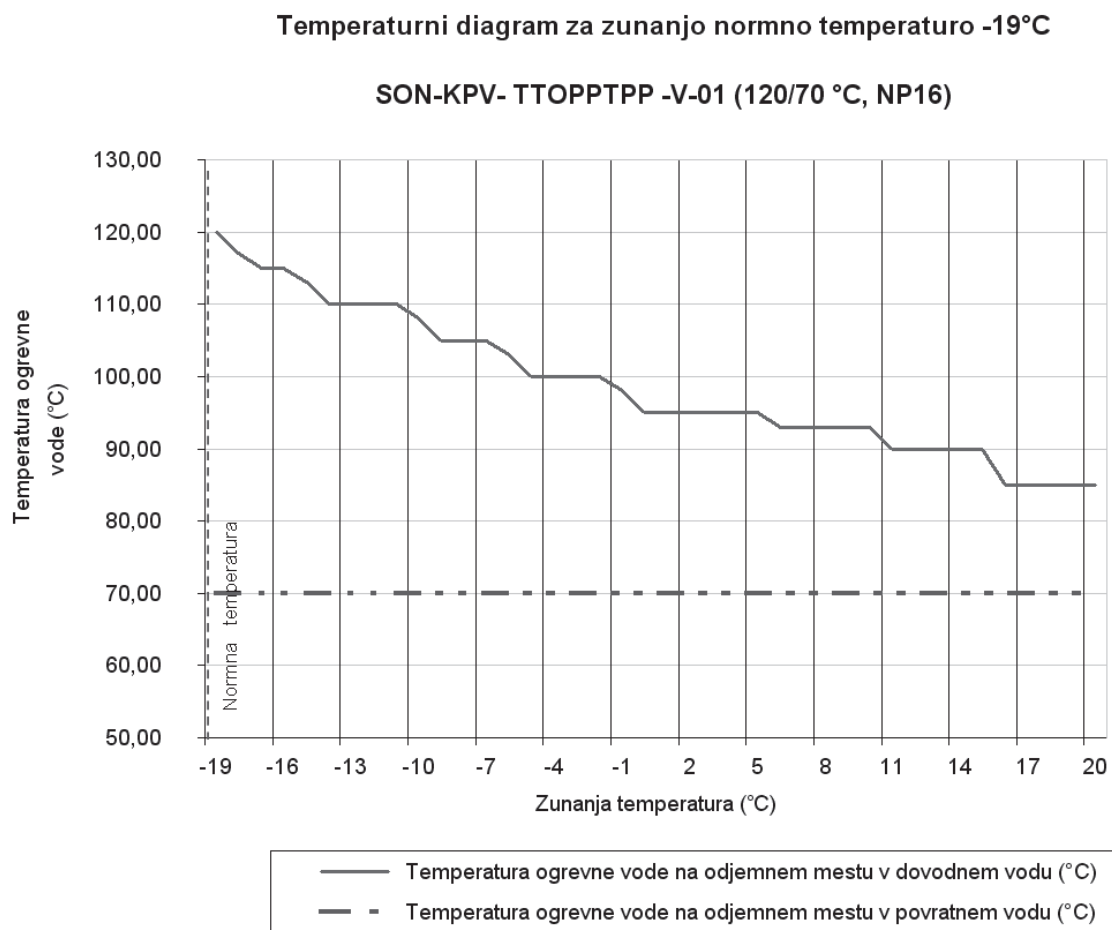


Opomba:

Dovoljeno odstopanje temperature ogrevne vode na posameznem odjemnem mestu v dovodnem vodu je $\pm 3\text{ }^{\circ}\text{C}$.

D). Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$
(SON-KPV-TTOP2COMRVG-V-01 (110/70 $^{\circ}\text{C}$, NP6))

Temperaturni diagram za zunanjo normno temperaturo -19°C

SON-KPV-TTOP2COMRVG-V-01 (110/70 $^{\circ}\text{C}$, NP6)

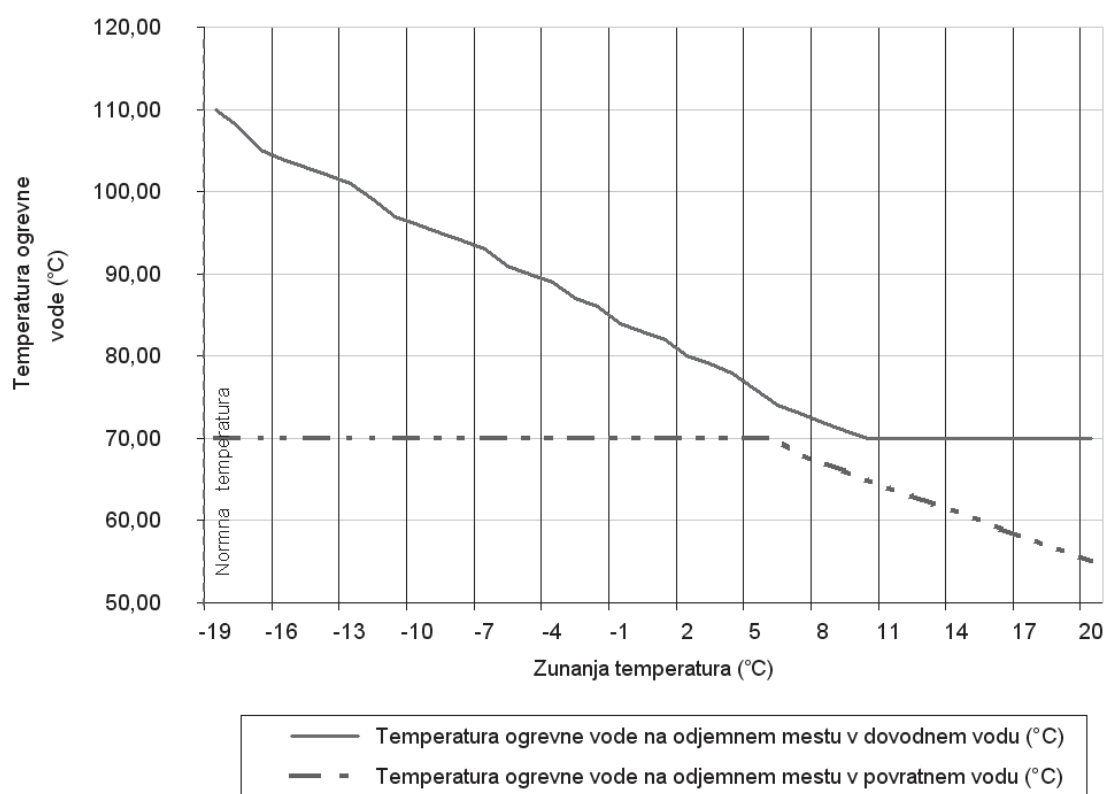


Opomba:

Dovoljeno odstopanje temperature ogrevne vode na posameznem odjemnem mestu v dovodnem vodu je $\pm 3\text{ }^{\circ}\text{C}$.

E). Temperaturni diagram za zunanjo normno temperaturo $-19\text{ }^{\circ}\text{C}$
(SON-KPV-TTOP2COMRVG-V-01 (85/65 $^{\circ}\text{C}$, NP3))

Temperaturni diagram za zunanjo normno temperaturo -19°C

SON-KPV-TTOP2COMRVG-V-01 (85/65 $^{\circ}\text{C}$, NP3)

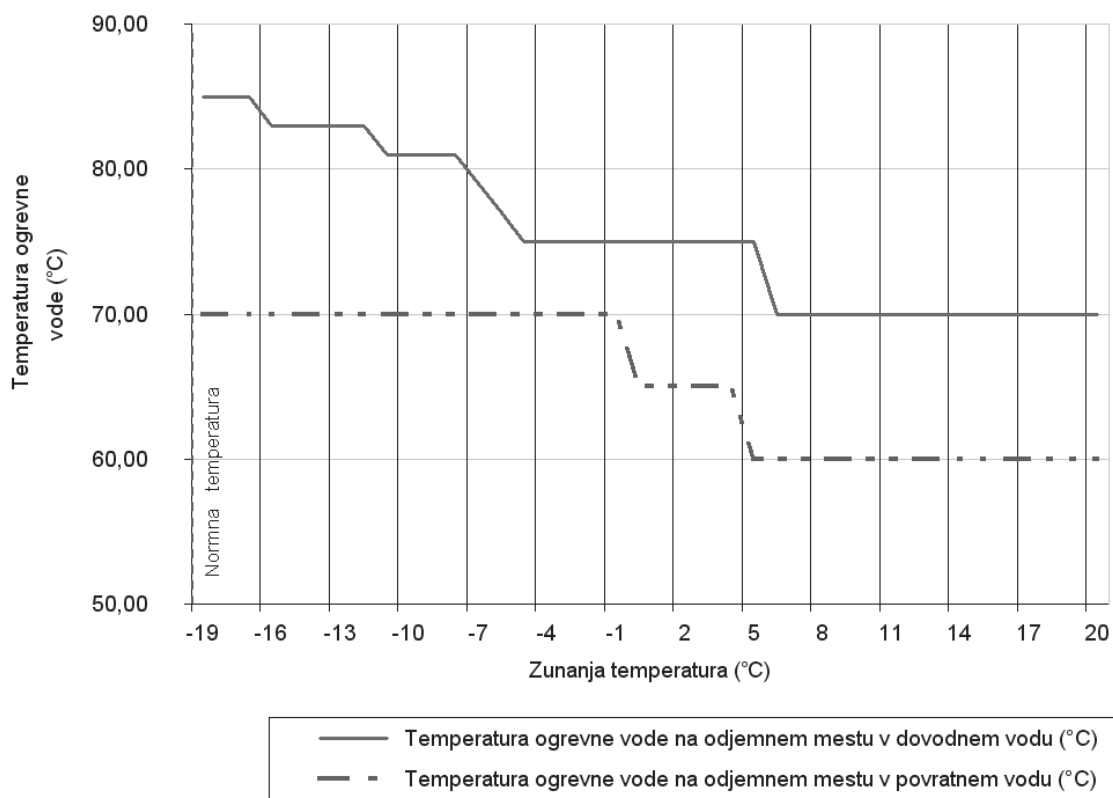

Opomba:

Dovoljeno odstopanje temperature ogrevne vode na posameznem odjemnem mestu v dovodnem vodu je $\pm 3\text{ }^{\circ}\text{C}$.